LIGHTING FIXTURE SCHEDULE				
DESIGN ID	**COUNT**	**DESCRIPTION**	**BULB**	**COMMENTS**
24300	4	2' STRIPLIGHT WITH DIFFUSE LENS 3000LM 80CRI 3500K	LED	ZL1N L24 3000LM WHITE
X0002	8	LED PARKING LOT LIGHITNG @45 - 2 @90 DEGREES	LED	HUBBELL LIGHTING: #RAR1-160L-100-4K7
ADDITIONAL LIGHTING EQUIP.				
T/C	1	TIME CLOCK		INTERMATIC 101R TIME CLOCK
EXIT				
11190	2	EXIT - EMERGENCY LIGHT - WHITE	LED	LITHONIA #AFN OEL
11483	1	EXIT - SECURITY LIGHT WALL MOUNTED	LED	
11517	3	EMERGENCY EXIT LIGHT - BLACK	LED	JUNO #NXPC-3-G-BL
RECESSED CAN				
19023	2	CAN - LED MOUNTING FRAME - 2IN 50MM - NEW CEILING	LED	
19035	2	CAN - LED ADJUSTABLE GIMBAL WITH DRIVER - 2IN 50MM - BLACK - 600LM SPOT	LED	
X0005	13	CAN - RECESSED HOUSING FOR LED ROUND TRIM - 2IN - NEW EXTERIOR CEILING ROUND	LED	JUNO #MD1LG2-927-SP-WH
SCONCE				
20820	8	SCONCE - SONNEMAN TRIFORM - TEXTURED BRONZE	(1) 3.5W 25700K, OR EQUAL	

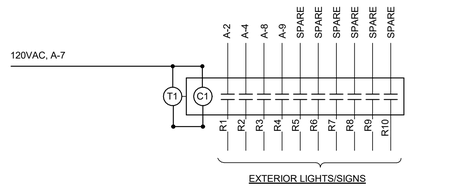

T1 - TORK #101R- 24 HOUR TIMECLOCK CONTROL: PROGRAM TO TURN ON AT 4:50 AM & OFF AT 1:00 AM (COORDINATE TIMES WITH STARBUCKS) & WITH 24 HOUR CONTROL TO TURN SIGNAGE OFF DURING DAYLIGHT AND ON AT DUSK .

3 TIME CLOCK DETAIL

Scale: N.T.S

KEYED NOTES

1. EMERGENCY/EXIT LIGHTS TO BE WIRED AHEAD OF ANY CONTROLS.
2. COORDINATE INSTALLATION REQUIREMENTS FOR AIR CURTAIN AND DT WINDOW WITH MANUFACTURER SPECIFICATIONS.
3. PROVIDE J-BOX FOR EXHAUST FAN. COORDINATE WIRING AND CONTROL WITH TENANTS CONSTRUCTION DOCUMENTS.
4. RTU FURNISHED WITH WEATHER PROOF/GFCI RECEPTACLE. E.C. SHALL PROVIDE WIRING TO EACH RECEPTACLE.
5. INTERIOR LIGHTING IS UNDER TENANT SCOPE OF WORK. PROVIDE TEMPORARY LIGHTS IN SHELL AS NEEDED TO MEET LOCAL CODE.
6. PROVIDE J-BOX FOR FUTURE BUILDING SIGNS. STUB CONDUITS INTO BUILDING WITH PULLSTRINGS. COORDINATE LOCATIONS WITH SIGNAGE VENDOR AND ARCH. ELEVATIONS.
7. PROVIDE EMERGENCY 90 MIN BACK UP BATTERY FOR NORMAL LIGHTING FIXTURE FOR EMERGENCY EGRESS PURPOSES, IN ACCORDANCE WITH LIFE SAFETY STANDARDS. COORDINATE EXACT LOCATION AND REQUIREMENTS WITH LIGHTING VENDOR AND CONSTRUCTION SUPERVISOR PRIOR TO ROUGH-IN.

GENERAL NOTES

A. ELECTRICAL CONTRACTOR SHALL COORDINATE WITH PLUMBING AND HEATING, VENTILATING, AND AIR CONDITIONING (HVAC) CONTRACTORS FOR ANY ADDITIONAL EQUIPMENT NEEDING POWER.

B. EQUIPMENT REQUIRES CONNECTION TO THE BUILDING ELECTRICAL SYSTEM. FURNISH AND INSTALL ALL NECESSARY CONDUIT, WIRE, CONNECTIONS, RECEPTACLES AND OVERCURRENT PROTECTION NECESSARY TO ENSURE THE EQUIPMENT FUNCTIONS PROPERLY AND COMPLIES WITH ALL APPLICABLE LOCAL AND NATIONAL CODES. COORDINATE EQUIPMENT REQUIREMENTS WITH MANUFACTURER CUT SHEET PRIOR TO ROUGH-IN.

C. REFERENCE LANDLORD WORK LETTER FOR DIVISION OF ELECTRICAL SCOPE OF WORK AND COORDINATE WITH STARBUCKS CONSTRUCTION MANAGER.

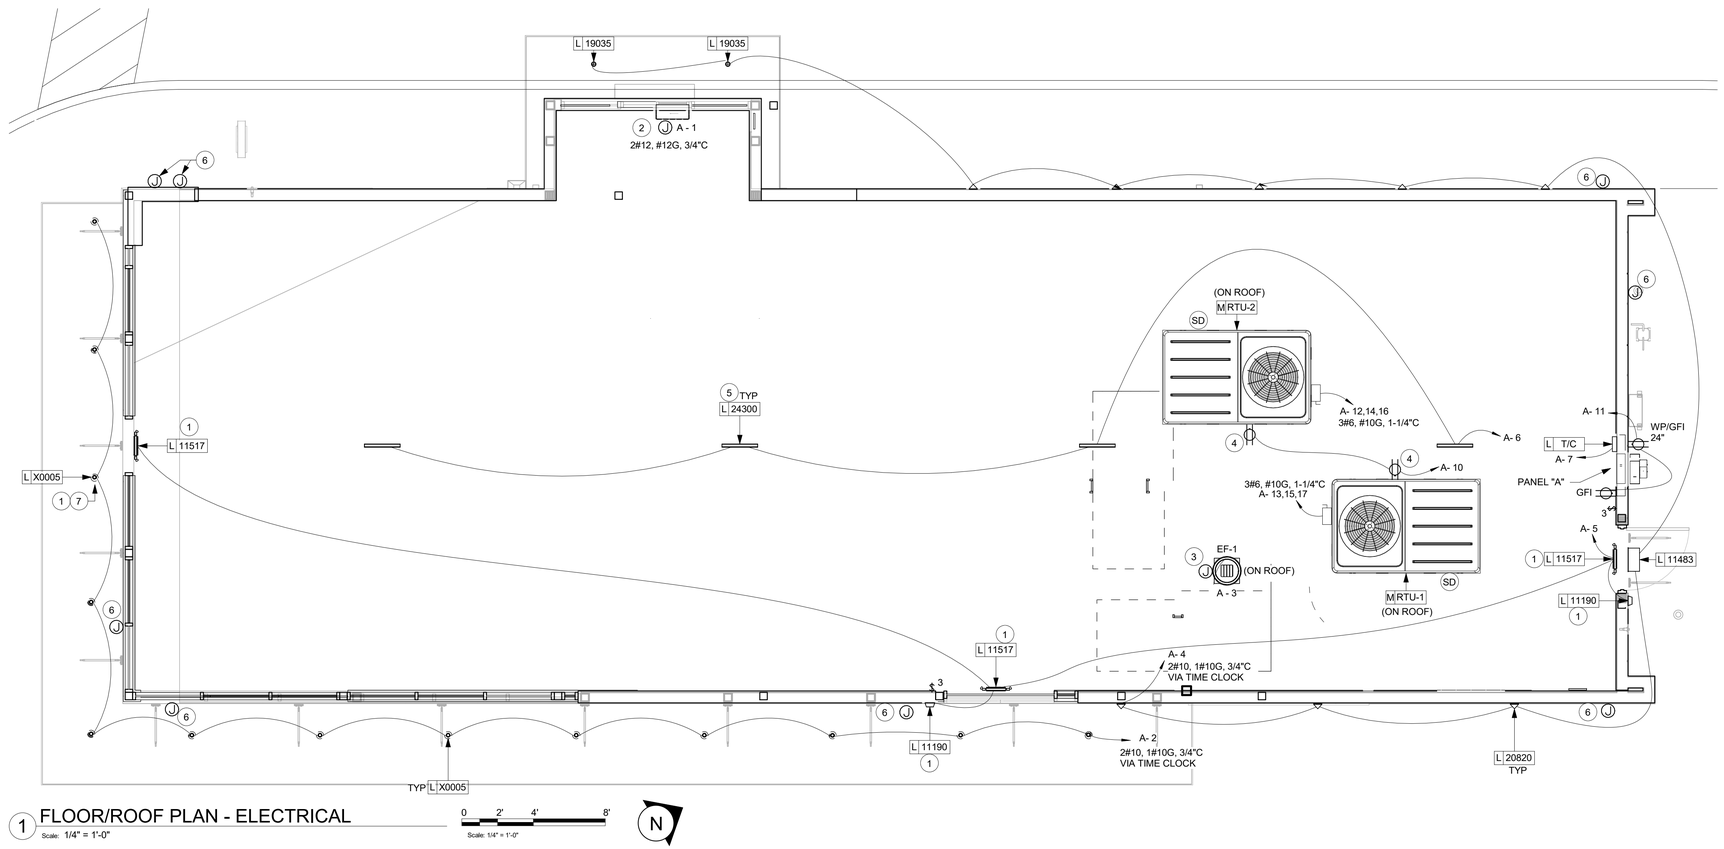

1 FLOOR/ROOF PLAN - ELECTRICAL

Scale: 1/4" = 1'-0"

0 2' 4' 8'

Scale: 1/4" = 1'-0"

N

GPD Engineering and Architecture
Professional Corporation - C3879

520 S. MAIN ST., SUITE 2531
AKRON, OH 44311
PHONE: 330.572.2100
FAX: 330.572.2101

Copyright: GPD Engineering and Architecture Professional Corporation 2020

REV.	DESCRIPTION	DATE

WHITSETT
6405 BURLINGTON RD
WHITSETT, NC 27377

FLOOR/ROOF PLAN - ELECTRICAL

	DATE
PERMIT	--/--/----
BID	--/--/----
CONSTRUCTION	--/--/----
RECORD	--/--/----

PROJECT MANAGER	DESIGNER
AK	AS

JOB NO.
2020379.16

E1002